



0575- 87696888

开式冷却塔 使用说明书

OPEN COOLING TOWER AN INSTRUCTION MANUAL

浙江金菱制冷工程有限公司
ZHEJIANG JINLING REFRIGERATION ENGINEERING CO., LTD

前 言

“ JLCT ”



目 录

①	_____	1	⑤	_____	11
②	_____	2-7	⑥	_____	12
③	_____	7-10	⑦	_____	13-17
④	_____	10			



1.1

- 1
- 2
- 3
- 4

- 5
- 6
- 7

1.2


1

2

1

3

2

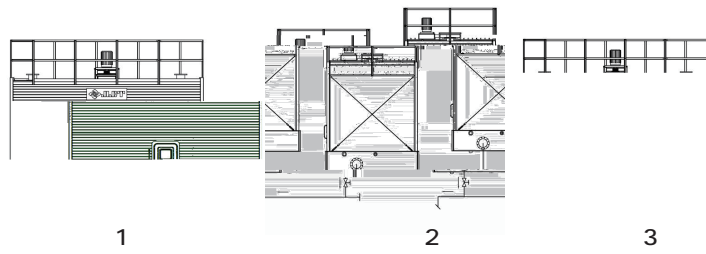

2.1

- 1
- 2
- 3

- 1
- 2
- 3


- 4
- 5

- 1
- 2
- 3

5



- 1
- 2
- 3
- 4

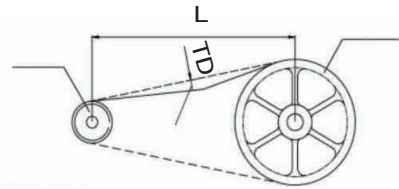


	86`	115`	152`	178`
TD kgl	2.1	2.3	2.5	2.5
t mm	26	28	32	33

- 1
- 2
- 3

- 1
- 2

- 1
- 2
- 3
- 4
- 5

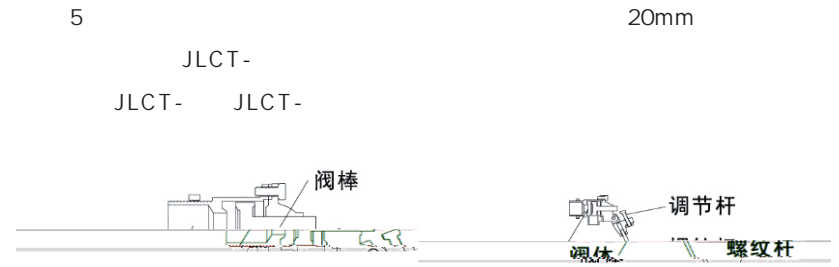

2.2
 1
 2
 80- 120mm
 3
 4
 5
 6
 2.3
 1
 2
 3
 80- 120mm
 4
 5
 6 PVC 50 CPVC 60 PP
 80
 7
 8



7


9
 10
 11
 12
 13
 14
 15
 16
 17
 18
 19
 20 /
 21
 22
 23
 24



25
26



3.1

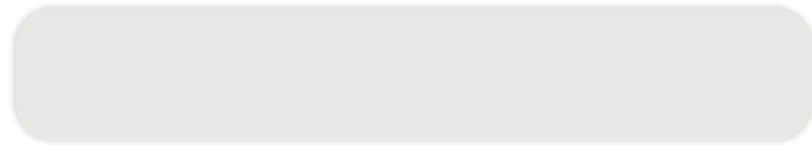

1
2
3
4
5
6
7

N320 00# 2#

8
9
10
11
12
13
14
3.2
1
2
3
4
5

PVC
0.38M





